


Device configuration 57018:

Measuring - Accessories

Making settings for the CO2 sensor


Automated method:

Download the appropriate XML configuration file for your device.




Compatible devices	Port 1	Port 2	Ports 1+2
57641	-	Download	-
57662	Download	Download	Download

In the WuTility-Configuration menu select the parameter "Restore saved configuration".

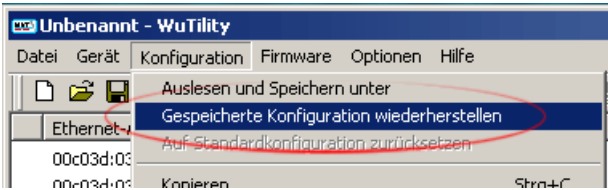


Select the respective XML file and confirm you selection by clicking on OK.

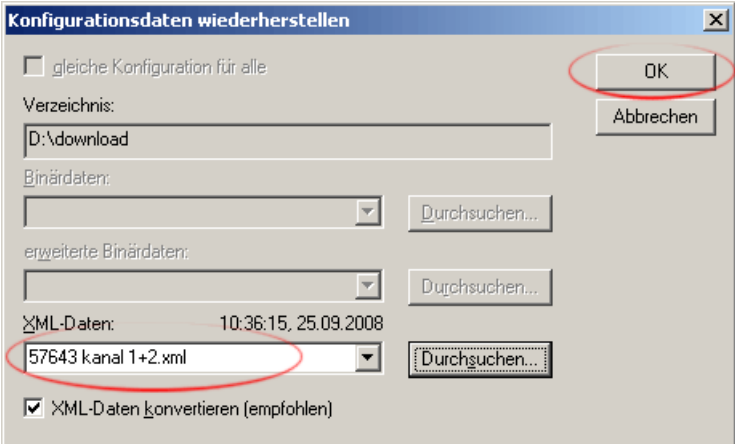

The device is now configured for operation with the CO2 sensor 57018.

Manual method:


Log in to the configuration interface of the device in the Web browser and set the respective port input to 0-10V.



Select Sensor : 0 - 10V
 Disconnect

[Zwischenspeichern](#)

For 0% scaling set the value "0" and for 100% scaling the value "2000".

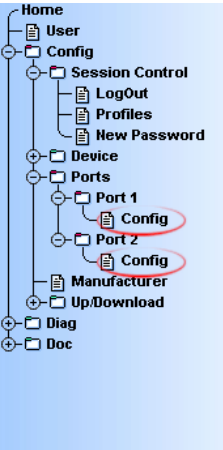

Config >> Ports >> Port 1 >> Config



Unit : Angezeigte Einheit

Scale 0% : Anzeigewert bei 0%

Scale 100% : Anzeigewert bei 100%

Freier Speicher: 49739 Bytes

[Zwischenspeichern](#) [Rücksetzen](#) [Logout](#)

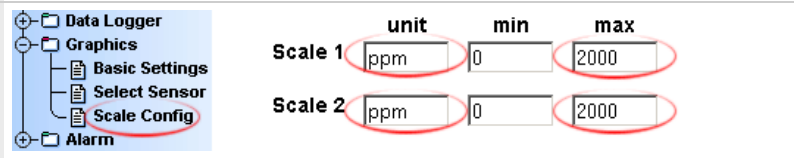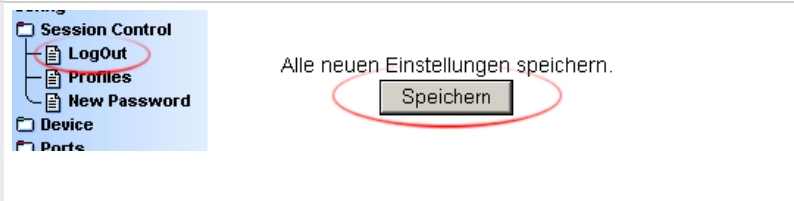Adjust the parameters for the graphical output to the sensors.	
In the logout menu store the settings you have made.	

The device is now configured for operation with the CO2 sensor 57018.



We are available to you in person:

Wiesemann & Theis
 GmbH
 Porschestra. 12
 42279 Wuppertal
 Phone: +49 202/2680-110 (Mon.-Fri. 8 a.m. to 5
 p.m.)
 Fax: +49 202/2680-265
 info@wut.de

© Wiesemann & Theis GmbH, subject to mistakes and changes: Since we can make mistakes, none of our statements should be applied without verification. Please let us know of any errors or misunderstandings you find so that we can become aware of and eliminate them.

[Data Privacy](#)